





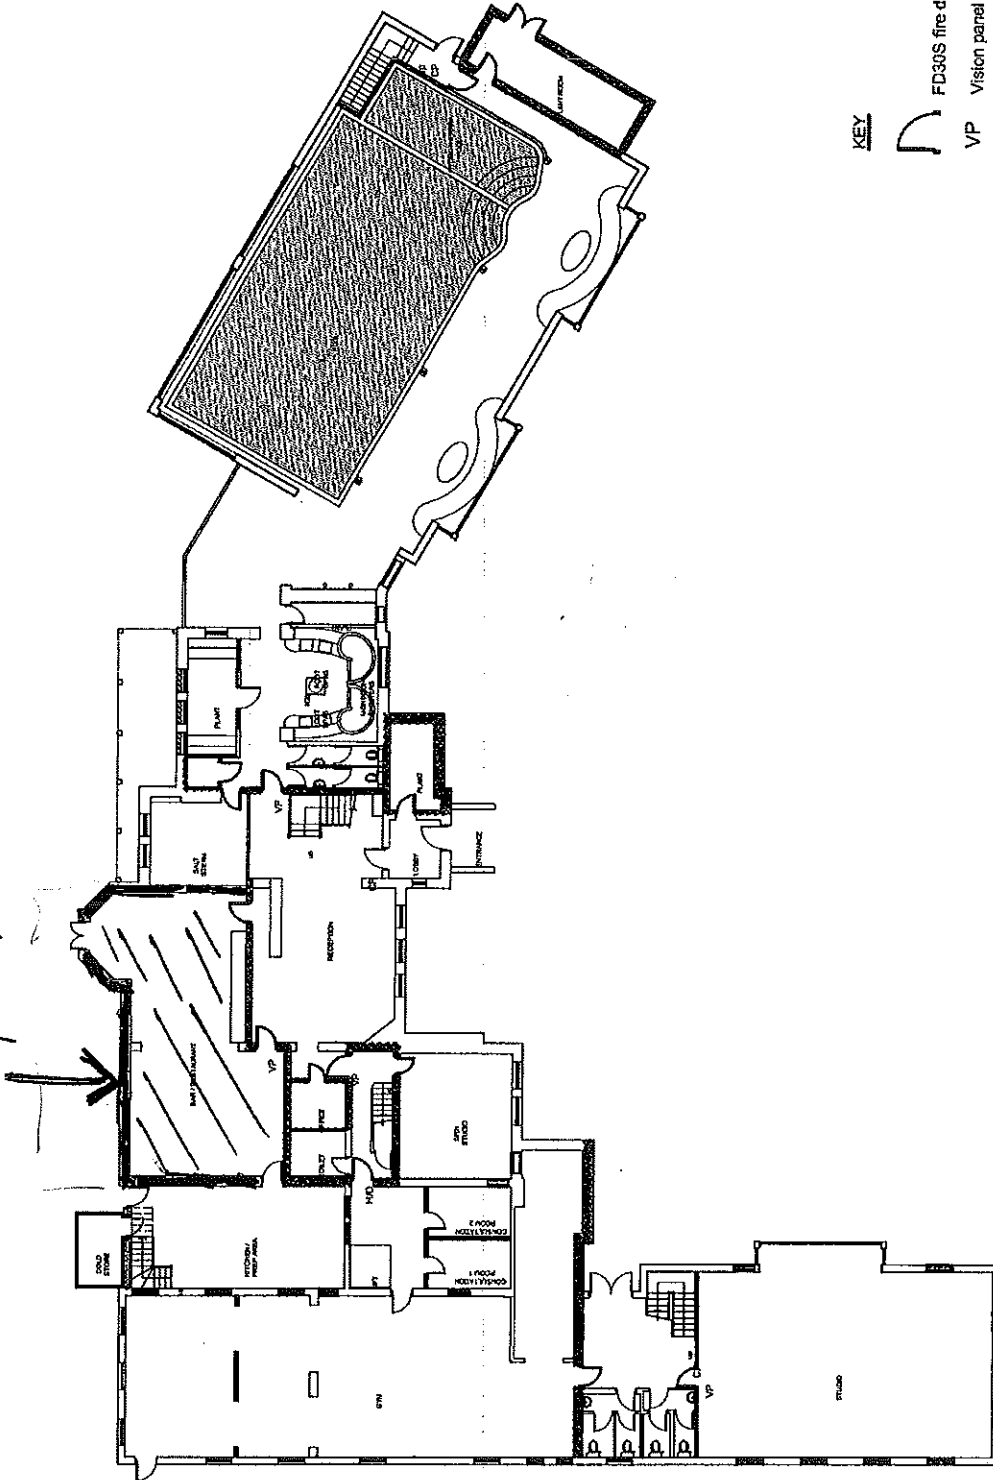


**KEY**






-  FD30S fire door
  -  VP Vision panel
  -  H/O Door hold open device wired to fire alarm
  -  CP Manual fire alarm call point
  -   Smoke detectors to BS 5839 part 1
- Fire alarm to BS 5839 part 1  
 Emergency lighting to BS 5266 part 1  
 Fire exits signage to BS 5499 part 1  
 Fire extinguishers to BS 5306 part 1  
 60 minutes fire resistance to all floors

FIRST FLOOR PLAN 1:200

*Bar/Restaurant*



**KEY**

-  FD30S fire door
-  VP Vision panel
-  H/O Door hold open device wired to fire alarm
-  CP Manual fire alarm call point
-  SD Smoke detectors to BS 5839 part 1

- Fire alarm to BS 5839 part 1
- Emergency lighting to BS 5266 part 1
- Fire exits signage to BS 5499 part 1
- Fire extinguishers to BS 5308 part 1
- 60 minutes fire resistance to all floors

GROUND FLOOR PLAN 1:200